


THE "NOWRA" 5150 LITRE COLLECTION WELL

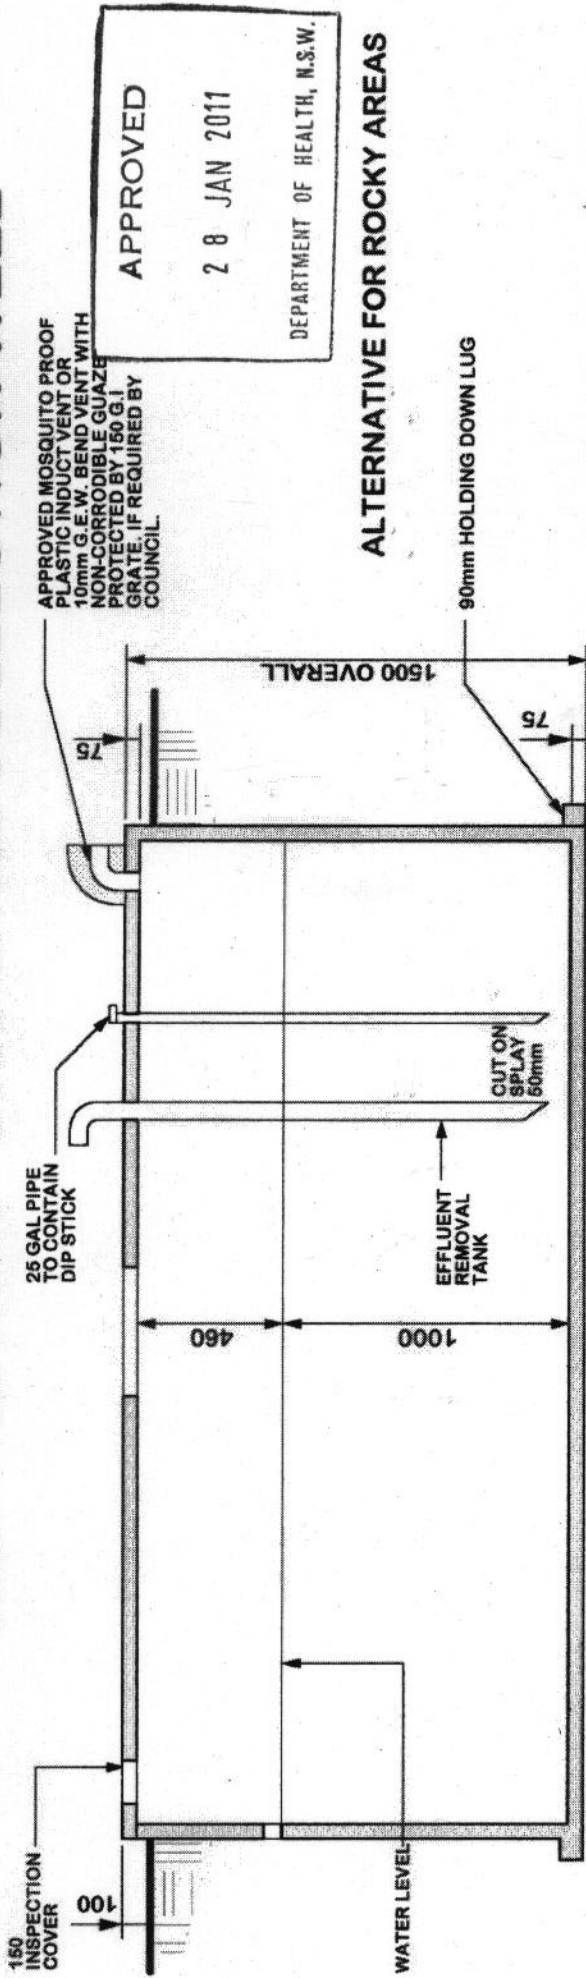

APPROVED

28 JAN 2011

DEPARTMENT OF HEALTH, N.S.W.

ALTERNATIVE FOR ROCKY AREAS

90mm HOLDING DOWN LUG

1500 OVERALL

75

75

75

3150

75

Sectional Elevation

3350 OVERALL

WATER PROOF JOINTS

1980 OVERALL

MANHOLE MIN. DIA. 500mm

NOTES/ SPECIFICATIONS

- When an installed unit is likely to displace ground water, The excavation is to be permanently drained or alternately, The unit is to be adequately anchored to prevent movement of the empty vessel.
- Concrete reinforced with fibre steel, minimum concrete strength 35mpa after 28 days.
- All measurements in millimetres.

DETAILS

Name:

Lot: Street:

Locality:

Shire/ Mun:

No Of Persons:

bennett's

concrete products

286 Princes Highway
South Nowra PO Box 214
Nowra 2541
Tel/ Fax (BH) 0244 223 861
Tel (AH) 0244 221 902
A.C.N No 061 849 349

Plan

