



THE "NOWRA" SEPTIC TANK

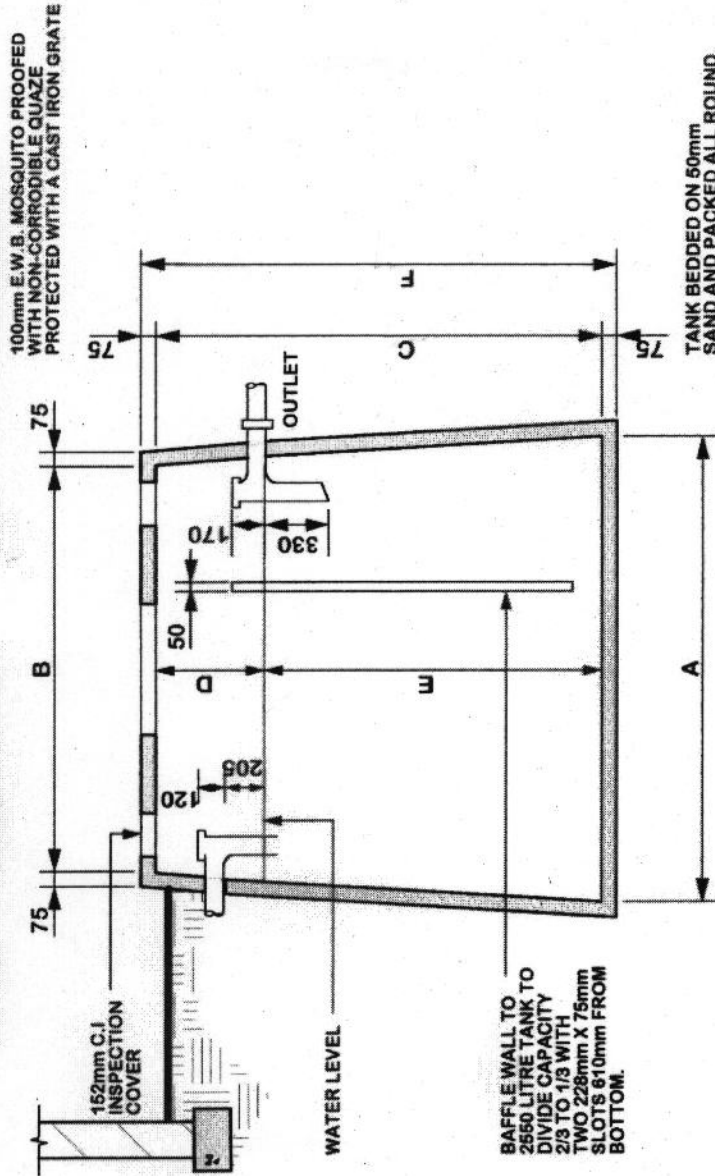

Sectional Elevation

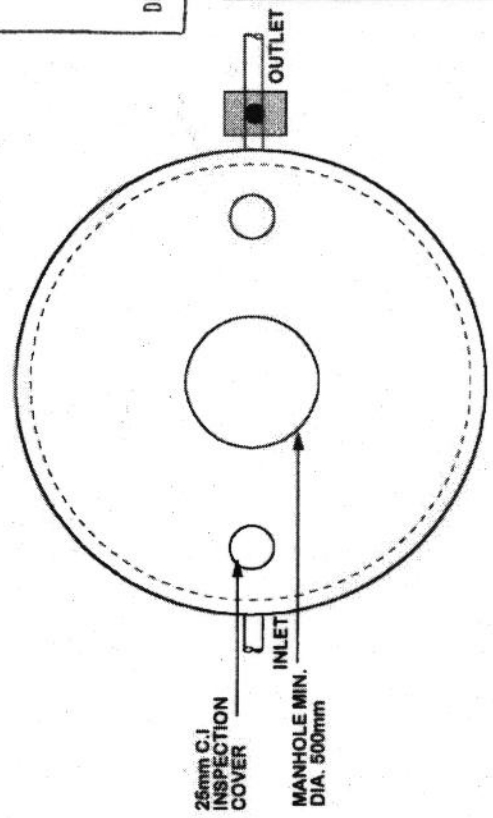

Plan

APPROVED
2 8 JAN 2011
DEPARTMENT OF HEALTH, N.S.W.

Wastes To Be Connected	
All Wastes	
WC (3-6 litre dual flush)	
WC (11.25-13 litre flush)	
Basin	
Bath	
Kitchen	
Laundry	

NOTES/ SPECIFICATIONS

- When an installed unit is likely to displace ground water. The excavation is to be permanently drained or alternately, The unit is to be adequately anchored to prevent movement of the empty vessel.
- Final ground surface over absorption area to be at least one inch below invert of septic tank outlet.
- All measurements in millimetres.
- Tank cast in one piece, With tapered finish to resist floatation.
- Concrete reinforced with a.s f41 mesh or equivalent. Minimum concrete strength 32 mpa after 28 days.
- Concrete reinforced with fibre steel, minimum concrete strength 35mpa after 28 days.
- 4.25 litre flush units must be fitted with a restricted flushing cistern and 25mm seal pedestal pan stamped as approved by the M.W.S. and D. Board.

LEGEND

Mark	A	B	C	D	E	F	CAPACIT LITRES
	Bottom Dia.	Top Int. Dia.	Int. Height	Air Gap	Liquid Depth	Overall Height	
	1600	1500	1450	350	1100	1600	2050
	1810	1810	1430	415	1015	1580	2550
	1690	1785	1880	335	1550	2035	3400

DETAILS

Name: _____ Street: _____

Lot: _____

Locality: _____

Shire/ Mun: _____

No Of Persons: _____

bennett's
concrete product

286 Princes Highway
South Nowra PO Box 214
Nowra 2541
Tel/Fax (BH) 0244 223 861
Tel (AH) 0244 221 902
A.C.N No 061 849 349